


**NOTES:**

1. ALL CO-ORDINATES SHOWN TO ITM.
2. ALL DETAILS TO BE IN ACCORDANCE WITH IRISH WATER STANDARD WATER DETAILS.
3. ALL WORKS TO BE CARRIED OUT IN ACCORDANCE WITH IRISH WATER CODE OF PRACTICE.

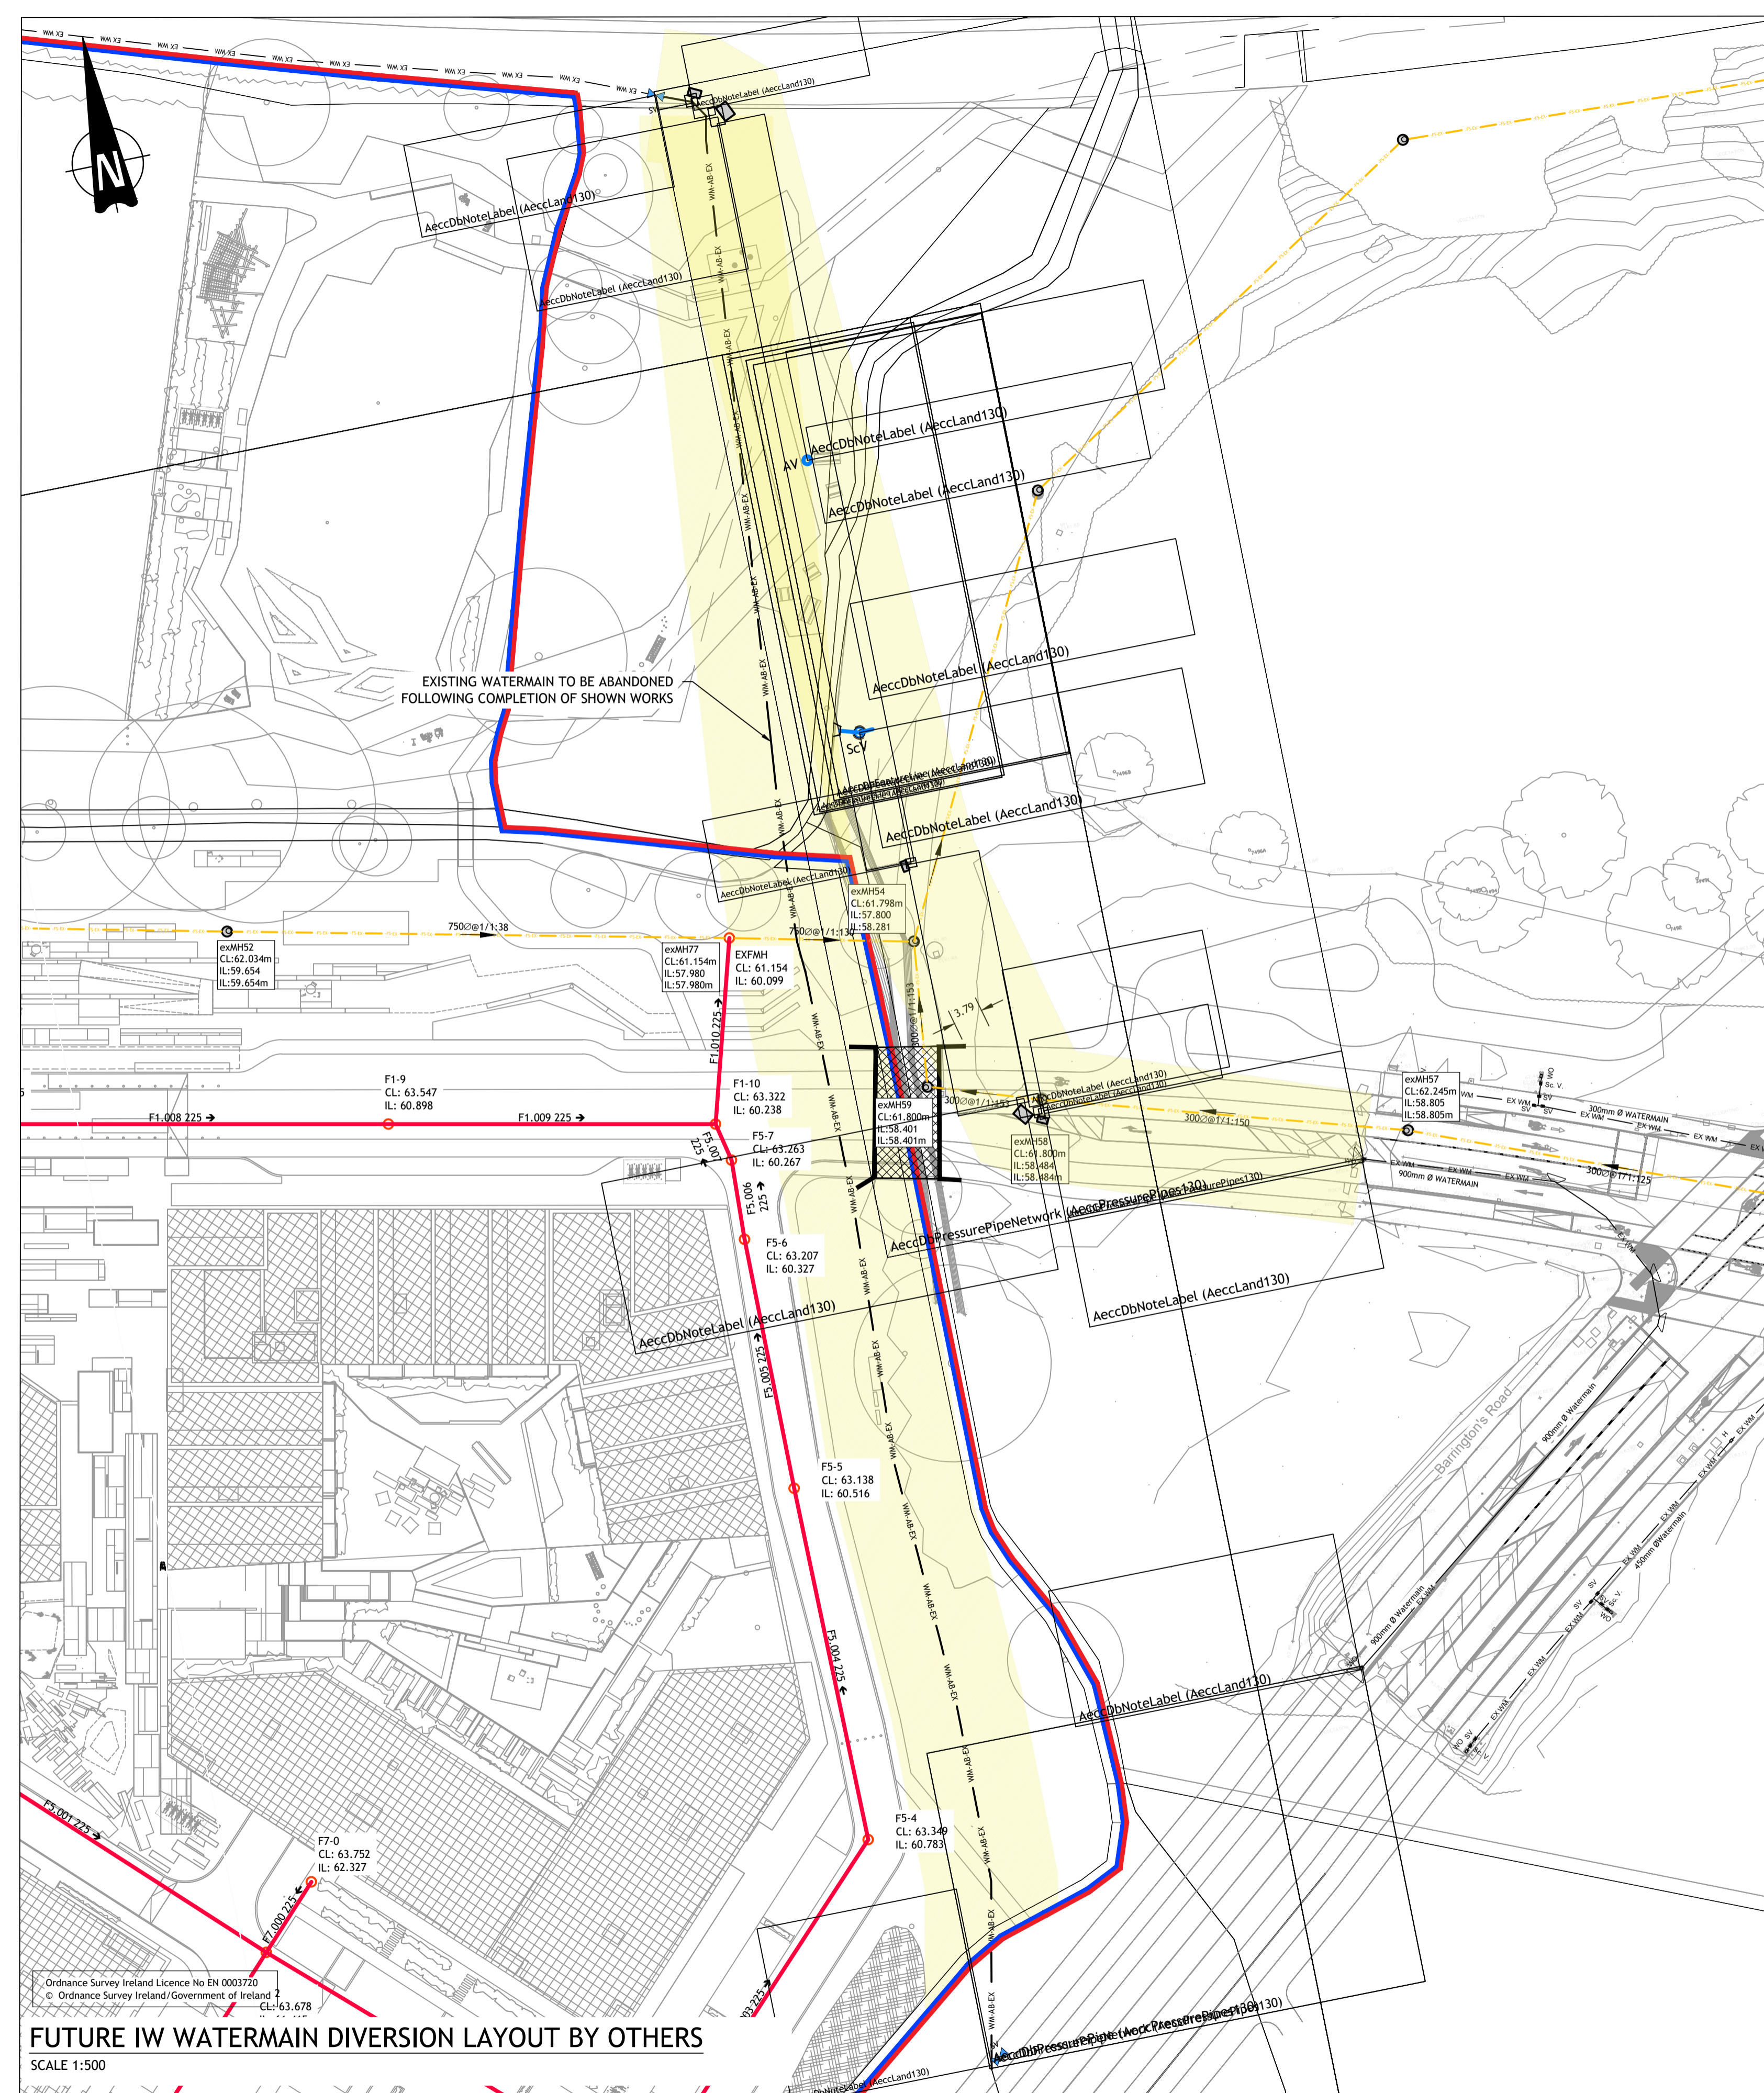

**LEGEND:**

- EXISTING 33" WATERMAIN (RECORD DRAWINGS SHOWN THUS) — EX WM — EX WM — EX WM —
- EXISTING 33" WATERMAIN TO BE ABANDONED — WM-AB-EX — WM-AB-EX —
- EXISTING WASH OUT HYDRANT — WO —
- EXISTING SCOUR VALVE — S.V. —
- EXISTING SLUICE VALVE — S.V. —
- EXISTING THRUST BLOCK —
- PROPOSED Ø900mm HDPE PE-80 SDR11 TO ISEN 12201-PART 1 AND PART 2 AND ISEN 12201-3 WATERMAIN DIVERSION — — — — —
- PROPOSED FUTURE WATERMAIN SERVICES (NOT PART OF THIS APPLICATION) — — — — —
- PROPOSED THRUST BLOCK (TYPE AS SHOWN ON PLAN) —
- PROPOSED SLUICE VALVE — S.V. —
- PROPOSED AIR VALVE — A.V. —
- PROPOSED SCOUR VALVE CHAMBER — S.C.V. —
- PROPOSED HEADWALL — H.W. —
- PROPOSED THRUST BLOCK —
- 16.825 METRE WAYLEAVE CENTRED ON PROPOSED WATERMAIN DIVERSION — — — — —
- EXISTING FOUL WATER SEWER (SIZE AS NOTED ON PLAN) — F.W.S. — F.W.S. — F.W.S. — F.W.S. —
- PROPOSED FUTURE FOUL WATER SEWER (NOT PART OF THIS APPLICATION) — — — — —
- PROPOSED INDICATIVE FUTURE M&E SERVICES — — — — —

**FUTURE IW WATERMAIN DIVERSION LAYOUT BY OTHERS**

SCALE 1:500

© PUNCH Consulting Engineers  
 This drawing and any design herein is the copyright of the Consultants and must not be reproduced without their written consent.  
 All drawings remain the property of the Consultants.  
 Figured dimension only to be taken from this drawing.  
 Consultants to be informed immediately of any discrepancies before work proceeds.

COLOUR DRAWING

Date Drawn:	JANUARY 2019
Drawn By:	IB Skoric
Date Issued:	2020-07-31
Issued By:	JB



Rev	Amendment	By	Date

Client:  
**1 CARRICKMINES LANDS LTD.**

Job: PRIOSLAND DEVELOPMENT  
 Title: FUTURE IRISH WATER WATERMAIN DIVERSION LAYOUT - PERMANENT PROPOSAL

**PUNCH** consulting engineers  
 Dublin | Limerick | Cork | Galway | Glasgow  
 Carnegie House, Library Road, Dun Laoghaire, Co. Dublin, A96 C7W7  
 IRL: +353 1 271 2200 www.punchconsulting.com

Stage:	PLANNING
Scale @ A1:	1:500
Technician Check:	IBS
Engineer Check:	MCD
Approved:	
Rev:	

182-186-031 PLO